


**IEC-CES Newtown Creek Water Quality Sampling Stations**

**Dissolved Oxygen Levels Spring Surveys**

- < 3.0 mg/L (hypoxic conditions/ inadequate for survival)
- 3.0-4.8 mg/L (unacceptable/below NYS Standard)
- 4.8-5.0 mg/L (unacceptable/does not meet IEC guidelines)
- >5.0 mg/L (adequate/ protective levels for aquatic life )

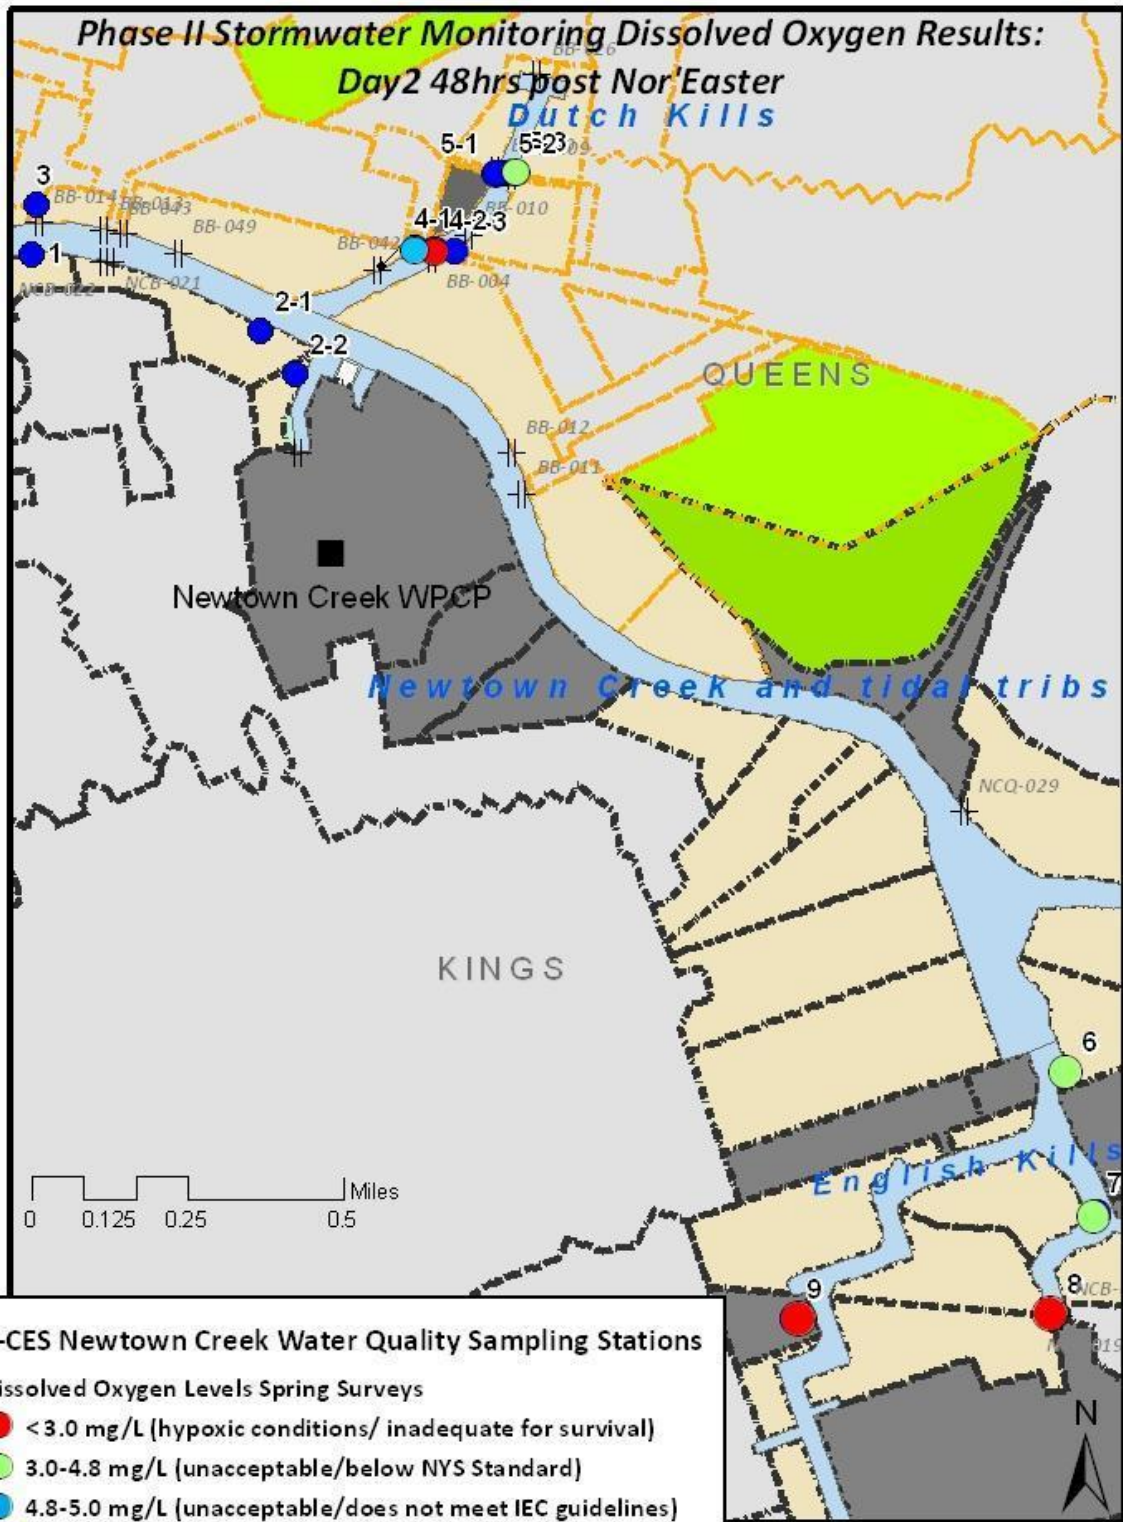

**IEC-CES Newtown Creek Water Quality Sampling Stations**

**Dissolved Oxygen Levels Spring Surveys**

- < 3.0 mg/L (hypoxic conditions/ inadequate for survival)
- 3.0-4.8 mg/L (unacceptable/below NYS Standard)
- 4.8-5.0 mg/L (unacceptable/does not meet IEC guidelines)
- >5.0 mg/L (adequate/ protective levels for aquatic life )